


EXPLORING

# EV PROTECTION IN PARKING GARAGES

The 2022 edition of **NFPA 13** has increased the recommended hazard classification for parking structures from Ordinary Hazard Group 1 to 2. The 2023 edition of **NFPA 88A** requires all parking garages to have sprinkler systems installed in accordance with **NFPA 13**. Prior to this edition, sprinklers were not mandatory in open parking structures.

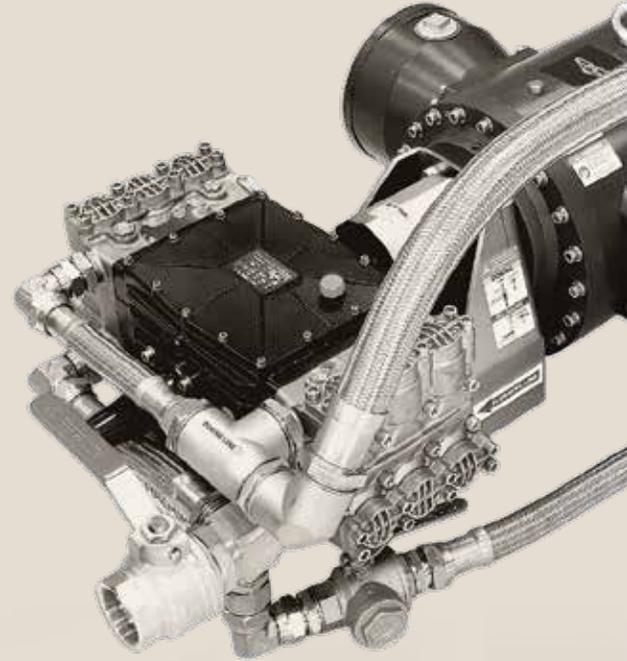

Stay prepared with our compact easy-to-install Diamond Doser Water-driven Proportioners powered by Encapsulator Technology.



## ANX 4.3 LITHIUM-ION BATTERIES

Encapsulator Agents (NFPA 18A Section 7.7) have been tested extensively by third-parties. This testing has documented fire suppression, control and the elimination of thermal runaway as well as the encapsulation of toxic off-gases.

**HAZARD CONTROL TECHNOLOGIES**


150 WALTER WAY, FAYETTEVILLE, GEORGIA 30214 / +1 770 719 5112 / INFO@HCT-WORLD.COM / HCT-WORLD.COM

MULTI-LEVEL

# PROTECTION



A WIDE RANGE  
OF FLOW SIZES  
FOR VERSATILE  
PROTECTION

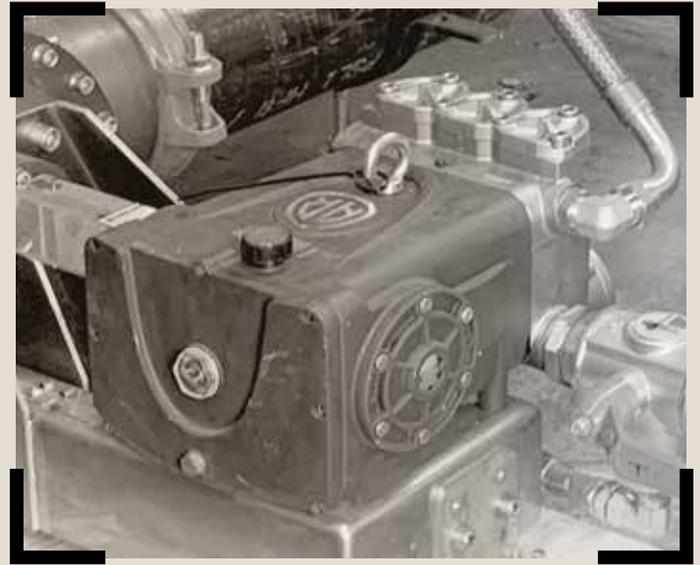

CLASS A MATERIALS

0.5% – 1%



CLASS B FUELS [POLAR + NON-POLAR]

3%



ENERGIZED ENVIRONMENTS

3%



CLASS D METALS

3%



LITHIUM-ION BATTERIES

3%

# PROPORTIONING

**FIXED OPTIONS**

0.1% 0.3% 0.5% 2% 2.75% 6%

**SELECTABLE OPTIONS**

0.3-0.6-1% 1-2-3% 0.5-3%

# PUMPS

We offer two models: Piston Pump and Gear Pump units.

**HAZARD CONTROL TECHNOLOGIES**

150 WALTER WAY, FAYETTEVILLE, GEORGIA 30214 / +1 770 719 5112 / INFO@HCT-WORLD.COM / HCT-WORLD.COM